
GERAND ENGINEERING
2300 EDGEWOOD AVE S, MINNEAPOLIS, MN 55426
952.374.1320 WWW.GERAND.COM

FIRE PUMP TEST METER
K-200-3

CONSTRUCTION & SPECIFICATIONS

MATERIALS:	CA36 ASTM B16 BRASS
VALVES:	RATED AT 600 WOG *VALVE BODY:* CAST BRONZE ASTM B584 *TAIL PIECE:* CA-360 B-16 *BALL:* BRASS CA-360 HARD CHROME *P* *LATED SEALS:* REINFORCED PTFE, 15% *GLASS FILLED HANDLE:* STEEL ASTM B633 W/ZINC PLATING
BRASS FITTING:	PIPE NIPPLE - B16 / 1/8" NEEDLE VALVE-B16 DISCONNECTS-B16
ID TAG:	CHAIN: BRASS TAG: ALUMINUM -3.21" THICK #200 MILL SET SCREW: STEEL ZINC PLATED
HOSES:	GOODYEAR 3/16" FREON CHARGING HOSES WITH NYTRIEE CORE, POLYESTER BRAID AND NYTRILE COVER WITH PVC FOR ABRASION RESISTANCE.

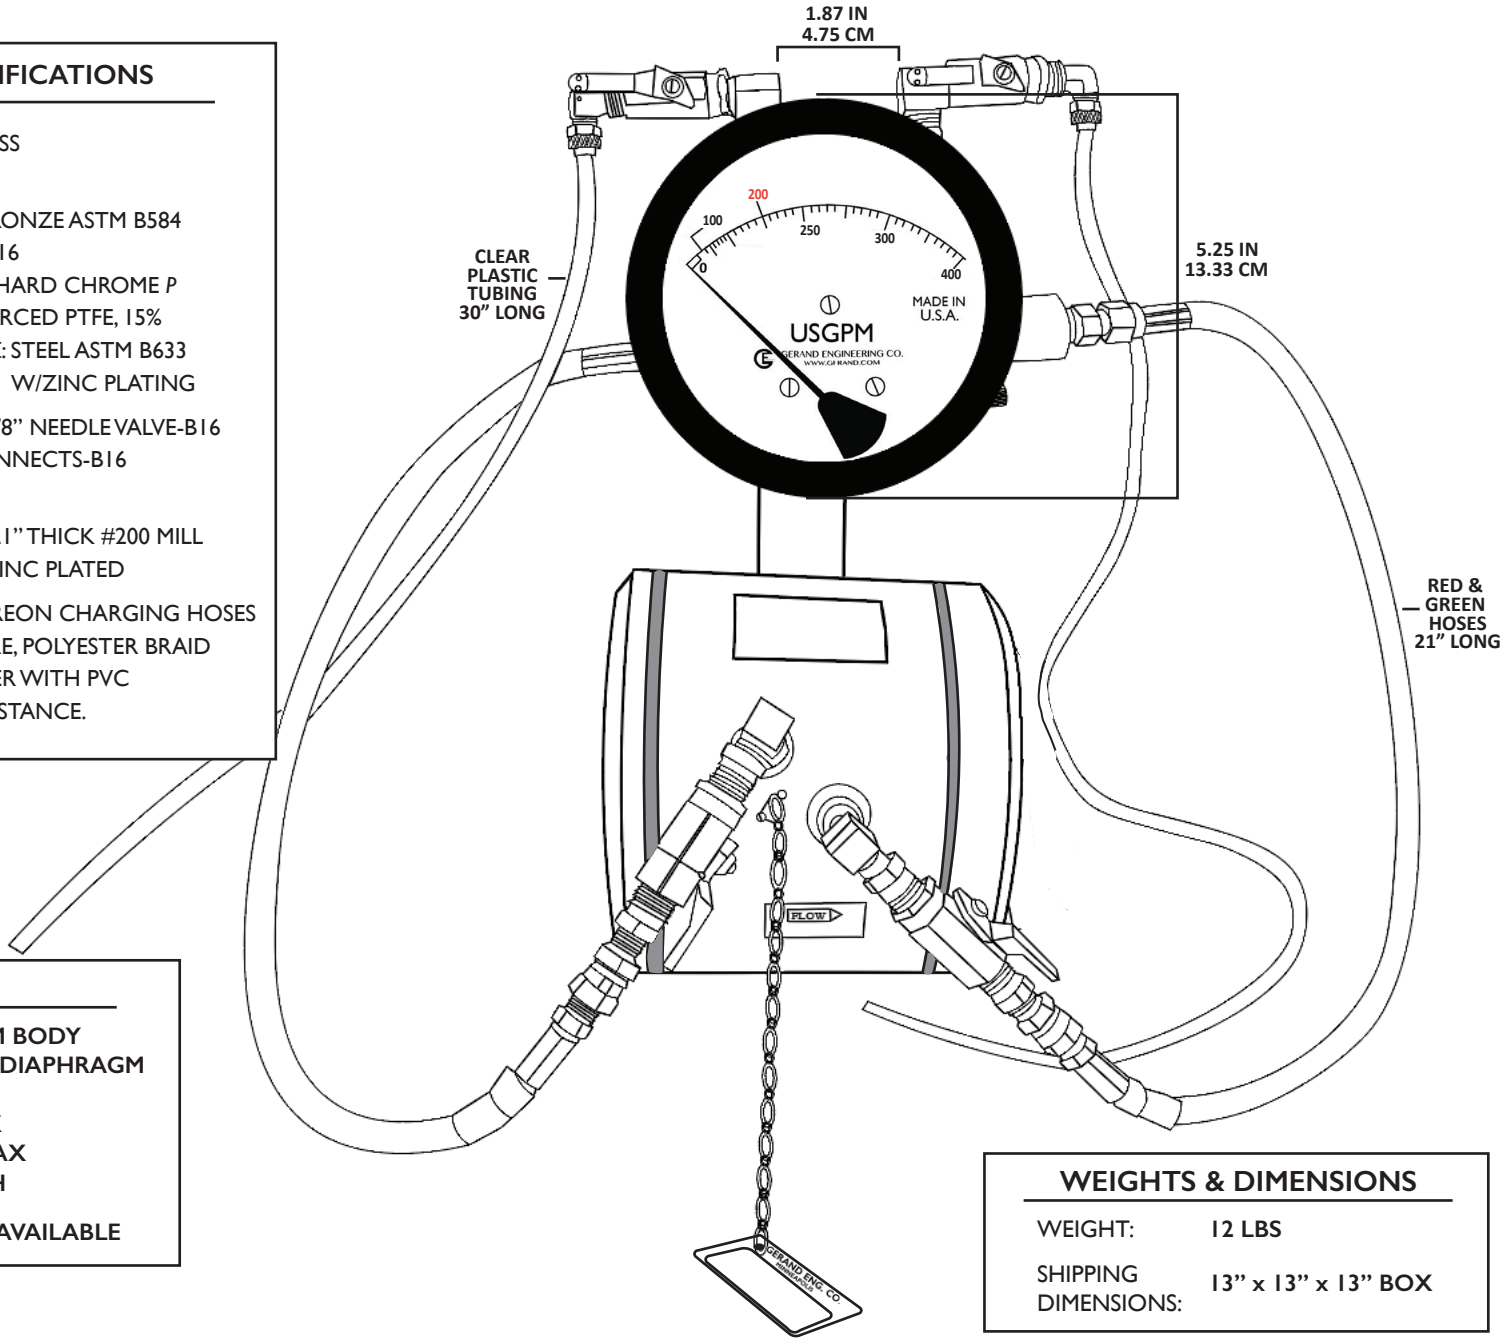

METER DATA

CONSTRUCTION:	**ALUMINUM BODY**
OPERATION:	**BUNA "N" DIAPHRAGM**
ACCURACY:	**±2.0%**
TEMPERATURE:	**200° F MAX**
PRESSURE:	**1500 PSI MAX**
APPROX. WEIGHT:	**3 LBS/EACH**

4 1/2" DIAL STANDARD - 6" AVAILABLE

WEIGHTS & DIMENSIONS

WEIGHT:	**12 LBS**
SHIPPING DIMENSIONS:	**13" x 13" x 13" BOX**