Series DS-1 – 5.6 K-factor, Dry-type Sprinklers Pendent, Upright, and Horizontal Sidewall Standard Response, Standard Coverage

IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

Scan the QR code or enter the URL in a web browser to access the most up-to-date electronic version of this document. Data rates may apply.

docs.jci.com/tycofire/tfp500

General Description

TYCO Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response (5 mm bulb), Standard Coverage Dry-type Sprinklers are decorative glass bulb automatic sprinklers typically used where:

- Pendent sprinklers are required on dry pipe systems that are exposed to freezing temperatures; for example, sprinkler drops from unheated portions of buildings
- Sprinklers and/or a portion of the connecting piping may be exposed to freezing temperatures (for example, sprinkler drops from wet systems into freezers, or horizontal piping extensions through a wall to protect unheated areas of a building such as loading docks, overhangs, and building exteriors)
- Sprinklers are used on systems that are seasonably drained to avoid freezing (for example, vacation resort areas)

NOTICE

Series DS-1 Dry-type Sprinklers described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), in addition to the standards of any other authorities having jurisdiction. Failure to do so may impair the performance of these devices.


The owner is responsible for maintaining their fire protection system and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.

Series DS-1 Dry-type Sprinklers must only be installed in fittings that meet the requirements of the Design Criteria section.

Sprinkler Identification Numbers (SINs)

TY3255 . . . . . Pendent
TY3155 . . . . . Upright
TY3355 . . . . . Horizontal Sidewall



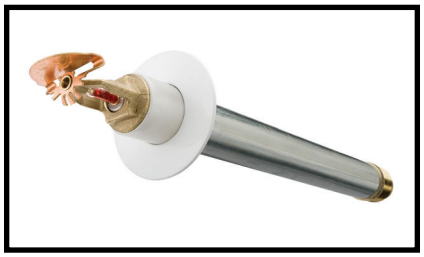

Technical Data

Approvals
UL and C-UL Listed
FM Approved
LPCB Approved
VdS Approved
CE Certified

Note: *For Approvals details, see Tables A and B.*

Maximum Working Pressure
175 psi (12,1 bar)

Inlet Thread Connections
1 in. NPT
ISO 7-R 1

Discharge Coefficient
K=5.6 gpm/psi^{½} (80,6 Lpm/bar^{½})

Temperature Ratings
See Tables A and B

Finishes
Sprinkler and Escutcheon, see Table D

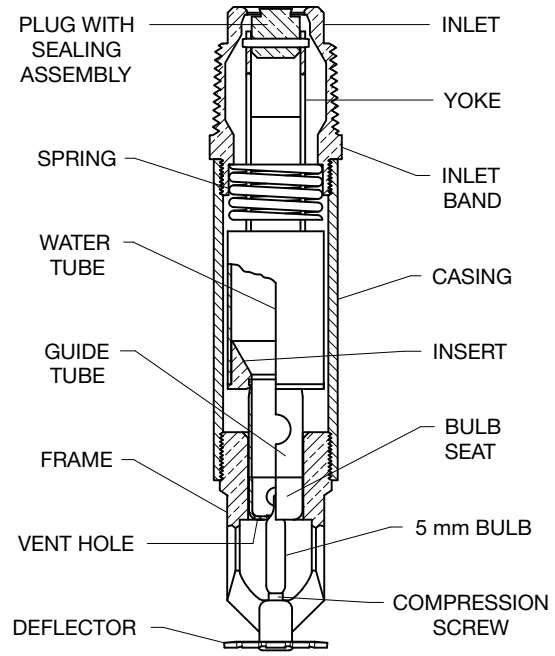


FIGURE 1
SERIES DS-1 DRY-TYPE SPRINKLER, 5.6K, STANDARD RESPONSE ASSEMBLY

Physical Characteristics

Inlet	Copper
Plug	Copper
Yoke	Stainless Steel
Casing	Galvanized Carbon Steel
Insert	Bronze
Bulb Seat	Stainless Steel
Bulb (5 mm dia.)	Glass
Compression Screw	Bronze
Deflector	Bronze
Frame	Bronze
Guide Tube	Stainless Steel
Water Tube	Stainless Steel
Spring	Stainless Steel
Sealing Assembly	Beryllium Nickel w/TEFLON
Escutcheon	Carbon Steel or Stainless Steel

Operation

When TYCO Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response, Standard Coverage Dry-type Sprinklers are in service, water is prevented from entering the assembly by the plug with sealing assembly (see Figure 1) in the inlet of the sprinkler.

The glass bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, and the Bulb Seat is released.

The compressed spring is then able to expand and push the water tube as well as the guide tube outward. This action simultaneously pulls inward on the yoke, withdrawing the plug with sealing assembly from the inlet, allowing the sprinkler to activate and flow water.

Design Criteria

TYCO Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response, Standard Coverage Dry-type Sprinklers are intended for use in fire sprinkler systems designed in accordance with the standard installation rules recognized by the applicable listing or approval agency (for example, UL Listing is based on NFPA 13 requirements). For more information on LPCB Approval, contact Johnson Controls at the following office:

Kopersteden 1
7547 TJ Enschede
The Netherlands
Tel: +31-(0)53-428-4444
Fax: +31-(0)53-428-3377

Sprinkler Fittings

Install 1 in. NPT Series DS-1 Dry-type Sprinklers in the 1 in. NPT outlet or run of the following fittings:

- Malleable or ductile iron threaded tee fittings that meet the dimensional requirements of ANSI B16.3 (Class 150)
- Cast iron threaded tee fittings that meet the dimensional requirements of ANSI B16.4 (Class 125)

Do not install Series DS-1 Dry-type Sprinklers into elbow fittings. The Inlet of the sprinkler can contact the interior of the elbow.

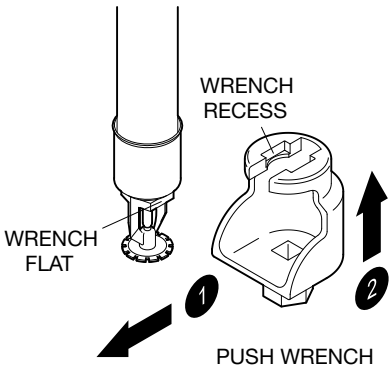


FIGURE 2
W-TYPE 7 WRENCH

The unused outlet of the threaded tee is plugged as shown in Figure 12.

You can also install Series DS-1 Dry-type Sprinklers in the 1 in. NPT outlet of a GRINNELL Figure 730 Mechanical Tee and GRINNELL G-FIRE Figure 522; however, the use of the Figure 730 Tee and Figure 522 for this arrangement is limited to wet pipe systems.

The configuration shown in Figure 13 is only applicable for wet pipe systems where the sprinkler fitting and water-filled pipe above the sprinkler fitting are not subject to freezing and where the length of the dry-type sprinkler has the minimum exposure length depicted in Figure 11. See the Exposure Length section.

For wet pipe system installations of 1 in. NPT Series DS-1 Dry-Type Sprinklers connected to CPVC piping, use the following CPVC fittings:

- 1 in. x 1 in. NPT female adapter
- 1 in. x 1 in. x 1 in. NPT sprinkler head adapter tee

Note: *For more information on specific CPVC fitting design and installation criteria, refer to CPVC manufacturer.*

For dry pipe system installations, use only the side outlet of maximum 2 1/2 in. reducing tee when locating Series DS-1 Dry-type Sprinklers directly below the branchline; otherwise, use the configuration shown in Figure 12 to assure complete water drainage from above Series DS-1 Dry-type Sprinklers and the branchline. Failure to do so may result in pipe freezing and water damage.

Sprinkler Type	Escutcheon Type	Temperature Rating	Bulb Liquid Color	Sprinkler Finish		
				Natural Brass	Chrome Plated	Polyester*
Pendent (TY3255)	Standard	155°F (68°C)	Red	1, 2, 3, 4, 5, 6		1, 2, 4, 5, 6
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve	1, 2, 3, 5, 6		1, 2, 5, 6
	Recessed	155°F (68°C)	Red	1, 2, 3		1, 2
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue	1, 2		
		360°F (182°C)	Mauve	N/A		
	Deep	155°F (68°C)	Red	1, 2, 3, 4, 5, 6		1, 2, 4, 5, 6
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve			
	Without	155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve	1, 2, 3, 5, 6		1, 2, 5, 6
Upright (TY3155)	Without	155°F (68°C)	Red	1, 2, 3, 4		1, 2, 4
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve	1, 2, 3		1, 2

NOTES
1. Listed by Underwriters Laboratories, Inc. (UL), maximum order length of 48 in.
2. Listed by Underwriters Laboratories for use in Canada (C-UL), maximum order length of 48 in.
3. Approved by FM Global (FM Approvals), maximum order length of 48 in.
4. Loss Prevention Certification Board (LPCB)
5. VdS Approved
6. CE Certified

* Frame and deflector only

TABLE A
SERIES DS-1 PENDENT & UPRIGHT DRY-TYPE SPRINKLERS, 5.6K, STANDARD RESPONSE LABORATORY LISTINGS AND APPROVALS

NOTICE

Do not install Series DS-1 Dry-type Sprinklers into any other type fitting. Failure to use the appropriate fitting may result in one of the following:

- *Failure of the sprinkler to operate properly due to formation of ice over the inlet plug or binding of the Inlet Plug*
- *Insufficient engagement of the Inlet pipe-threads with consequent leakage*

Drainage

In accordance with the minimum requirements of the NATIONAL FIRE PROTECTION ASSOCIATION for dry pipe sprinkler systems, branch, cross, and feed-main piping connected to dry sprinklers and subject to freezing temperatures must be pitched for proper drainage.

Exposure Length

When using dry sprinklers in wet pipe sprinkler systems to protect areas subject to freezing temperatures, use Table C to determine a sprinkler's appropriate exposed barrel length to prevent water from freezing in the connecting pipes due to conduction. The exposed barrel length measurement must be taken from the face of the sprinkler fitting to the surface of the structure or insulation that is exposed to the heated area. For an example, see Figure 11.

For protected area temperatures between those given above, the minimum recommended length from the face of the fitting to the outside of the protected area may be determined by interpolating between the indicated values.

Clearance Space

In accordance with NFPA 13, when connecting an area subject to freezing and an area containing a wet pipe sprinkler system, the clearance space around the sprinkler barrel of dry-type sprinklers must be sealed. Due to temperature differences between two areas, the potential for the formation of condensation in the sprinkler and subsequent ice build-up is increased. If this condensation is not controlled, ice build-up can occur that might damage the dry-type sprinkler and/or prevent proper operation in a fire situation.

Use of the Model DSB-2 Dry Sprinkler Boot, described in technical data sheet TFP591 and shown in Figures 14 and 15, can provide the recommended seal.

Sprinkler Type	Escutcheon Type	Temperature Rating	Bulb Color Code	Sprinkler Finish		
				Natural Brass	Chrome Plated	Polyester****
HSW* (TY3355)	Standard	155°F (68°C)	Red	1**, 2**, 3***, 4		1**, 2**, 4
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve			
	Deep	155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve			
	Without	155°F (68°C)	Red			
		175°F (79°C)	Yellow			
		200°F (93°C)	Green			
		286°F (141°C)	Blue			
		360°F (182°C)	Mauve	1**, 2**		1**, 2**

NOTES

1. Listed by Underwriters Laboratories, Inc. (UL), maximum order length of 48 in.
2. Listed by Underwriters Laboratories for use in Canada (C-UL), maximum order length of 48 in.
3. Approved by FM Global (FM Approvals), maximum order length of 48 in.
4. Loss Prevention Certification Board (LPCB) and CE conformity apply to these temperature ratings only

* Horizontal sidewall with top of deflector-to-ceiling distance of 4 to 12 in. (100 to 300 mm)
** Light and ordinary hazard occupancies only
*** Light hazard occupancies only
**** Frame and deflector only

TABLE B
SERIES DS-1 HORIZONTAL SIDEWALL (HSW) DRY-TYPE SPRINKLER, 5.6K, STANDARD RESPONSE LABORATORY LISTINGS AND APPROVALS

Installation

TYCO Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response, Standard Coverage Dry-type Sprinklers must be installed in accordance with this section.

General Instructions

Series DS-1 Dry-type Sprinklers must only be installed in fittings that meet the requirements of the Design Criteria section. See the Design Criteria section for other important requirements regarding piping design and sealing of the clearance space around the sprinkler casing.

Do not install any bulb-type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 in. (1,6 mm) for the 155°F (68°C) rating to 1/8 in. (3,2 mm) for the 360°F (182°C) rating.

Obtain a leak-tight 1 in. NPT sprinkler joint by applying a minimum-to-maximum torque of 20 ft-lb to 30 ft-lb (26,8 N·m to 40,2 N·m). Higher levels of torque may distort the sprinkler Inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in an escutcheon plate by under or over-tightening the sprinkler. Re-adjust the position of the sprinkler fitting to suit.

Notes:

- *Install pendent sprinklers only in the pendent position; install upright sprinklers only in the upright position. The deflector of a pendent or upright sprinkler is to be parallel to the ceiling.*
- *Install horizontal sidewall sprinklers in the horizontal position with their centerline of waterway perpendicular to the back wall and parallel to the ceiling. Ensure the word "TOP" on the deflector faces the ceiling.*

Step 1. With a non-hardening pipe-thread sealant such as TEFLON applied to the inlet threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 2. Wrench-tighten the sprinkler using either of the following tools:

- Pipe wrench on the inlet band or the casing, see Figure 1
- W-Type 7 sprinkler wrench on the wrench flat, see Figure 2

Apply the wrench recess of the W-Type 7 Sprinkler Wrench to the wrench flat.

Note: *If sprinkler removal becomes necessary, remove the sprinkler using the same wrenching method noted above. Sprinkler removal is easier when a non-hardening sealant was used and torque guidelines were followed. After removal, inspect the sprinkler for damage.*

Step 3. After installing the ceiling or wall and applying a ceiling finish, slide on the outer piece of the escutcheon until it comes in contact with the ceiling/wall. Do not lift the ceiling panel out of its normal position.

When using the deep escutcheon, hold the outer piece in contact with the mounting surface (ceiling or wall). Then rotate the inner piece approximately 1/4 turn with respect to the outer piece, to hold the deep escutcheon firmly together.

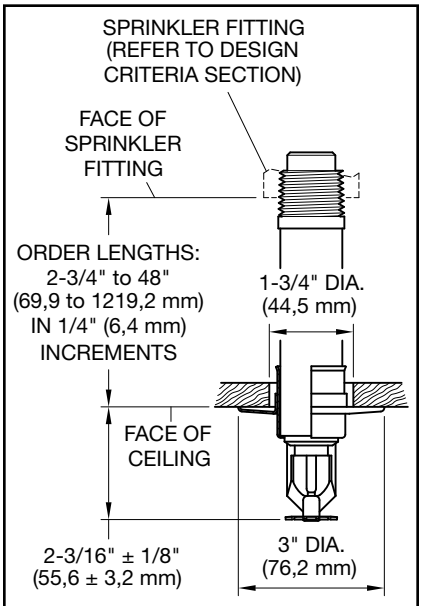


FIGURE 3
PENDENT (TY3255)
WITH STANDARD ESCUTCHEON

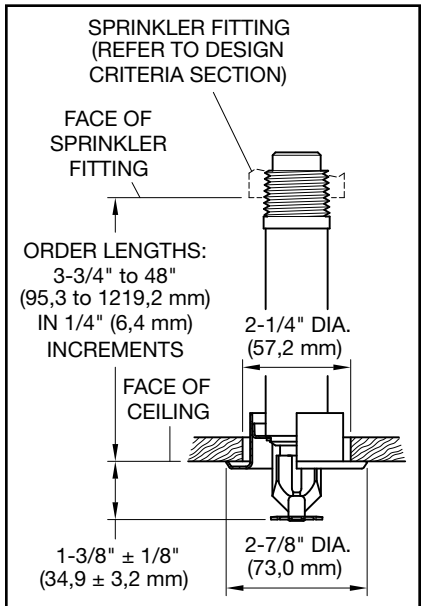


FIGURE 4
PENDENT (TY3255)
WITH STANDARD
RECESSED ESCUTCHEON

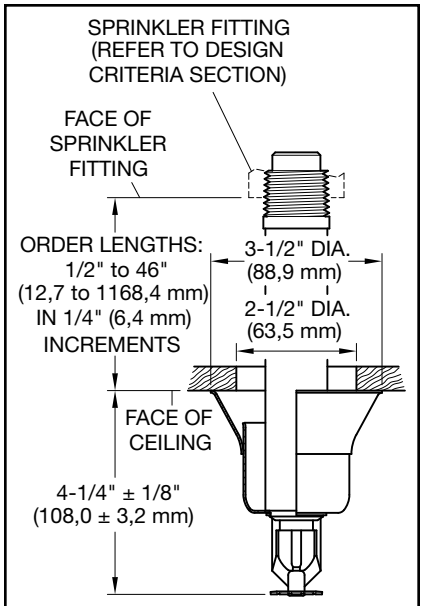


FIGURE 5
PENDENT (TY3255)
WITH DEEP ESCUTCHEON

Care and Maintenance

TYCO Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response, Standard Coverage Dry-type Sprinklers must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection systems from the proper authorities and notify all personnel who may be affected by this action.

Absence of the outer piece of an escutcheon, which is used to cover a clearance hole, may delay the time to sprinkler operation in a fire situation.

A vent hole is provided in the bulb seat (see Figure 1) to indicate if the dry sprinkler is remaining dry. Evidence of leakage from the vent hole indicates potential leakage past the Inlet seal and the need to remove the sprinkler to determine the cause of leakage; for example, an improper installation or an ice plug. Close the fire protection system control valve and drain the system before removing the sprinkler.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory.

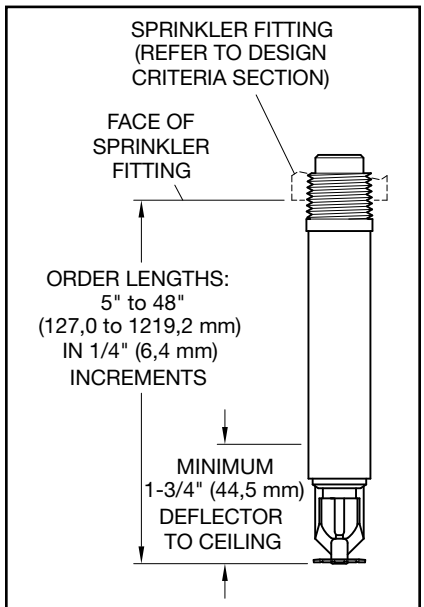


FIGURE 6
PENDENT (TY3255)
WITHOUT ESCUTCHEON

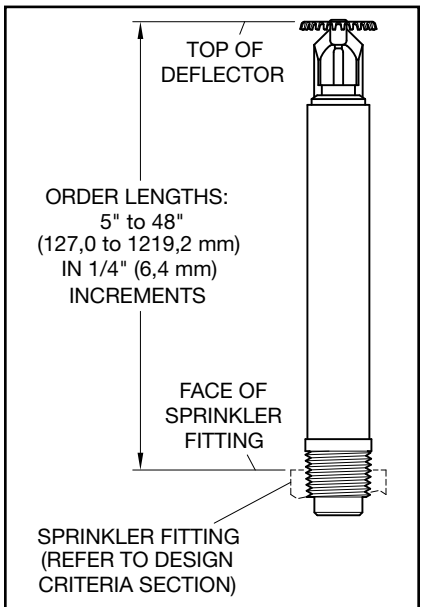


FIGURE 7
UPRIGHT (TY3155)
WITHOUT ESCUTCHEON

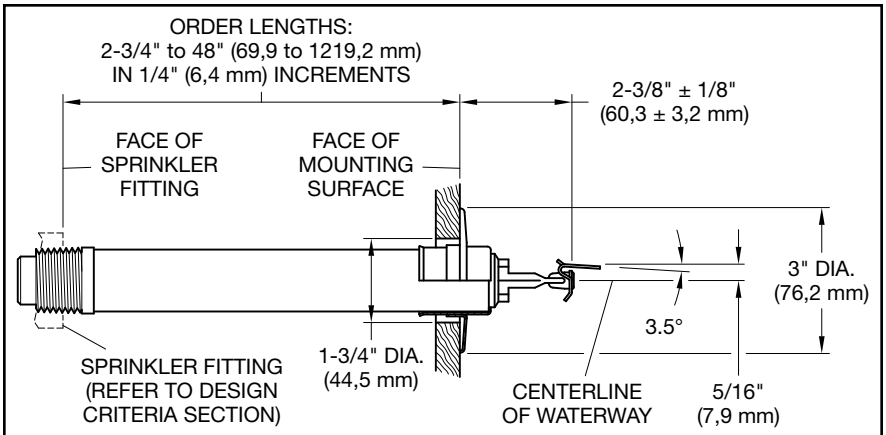


FIGURE 8
HORIZONTAL SIDEWALL (TY3355)
WITH STANDARD ESCUTCHEON

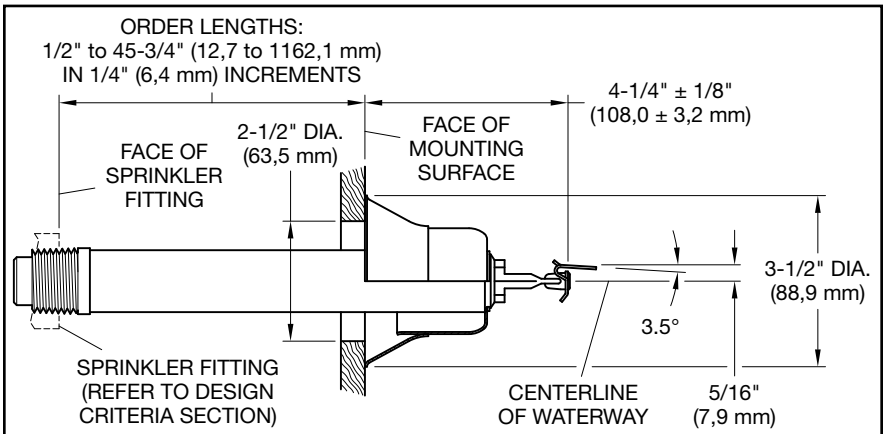


FIGURE 9
HORIZONTAL SIDEWALL (TY3355)
WITH DEEP ESCUTCHEON

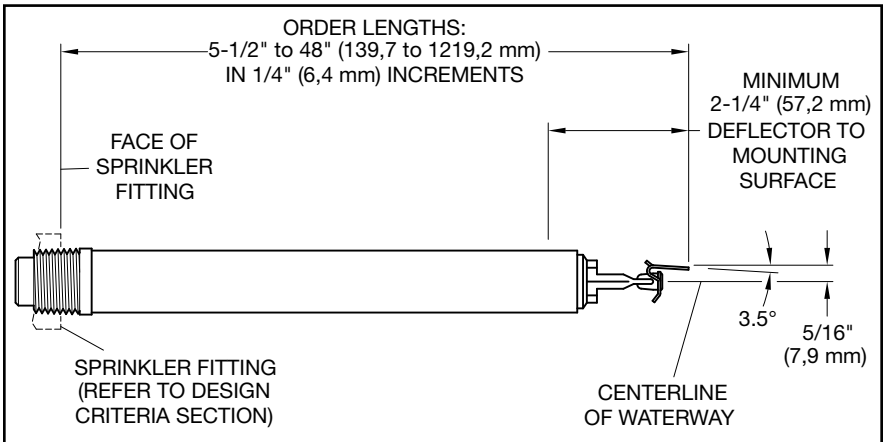


FIGURE 10
HORIZONTAL SIDEWALL (TY3355)
WITHOUT ESCUTCHEON

Modified sprinklers must be replaced. Sprinklers that have been exposed to corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.

Care must be exercised to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. See the Installation section.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION, such as NFPA 25, in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or product manufacturer with any questions.

Automatic sprinkler systems are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

Ambient Temperature Exposed to Discharge End of Sprinkler	Temperatures for Heated Area(1)		
	40°F (4°C)	50°F (10°C)	60°F (16°C)
	Minimum Exposed Barrel Length(2), in. (mm)		
40°F (4°C)	0	0	0
30°F (-1°C)	0	0	0
20°F (-7°C)	4 (100)	0	0
10°F (-12°C)	8 (200)	1 (25)	0
0°F (-18°C)	12 (305)	3 (75)	0
-10°F (-23°C)	14 (355)	4 (100)	1 (25)
-20°F (-29°C)	14 (355)	6 (150)	3 (75)
-30°F (-34°C)	16 (405)	8 (200)	4 (100)
-40°F (-40°C)	18 (455)	8 (200)	4 (100)
-50°F (-46°C)	20 (510)	10 (255)	6 (150)
-60°F (-51°C)	20 (510)	10 (255)	6 (150)

Notes:
1. For protected area temperatures that occur between values listed above, use the next cooler temperature.
2. These lengths are inclusive of wind velocities up to 30 mph (18,6 kph).

TABLE C
EXPOSED SPRINKLER BARRELS IN WET PIPE SYSTEMS MINIMUM RECOMMENDED LENGTHS

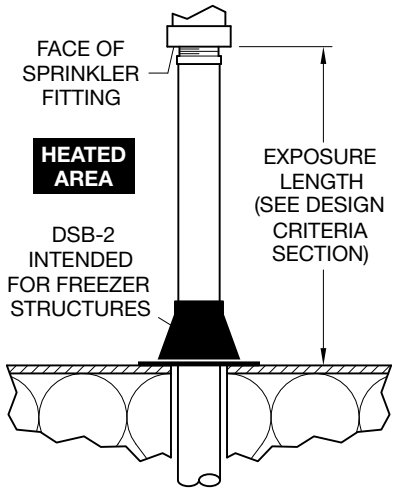


FIGURE 11
EXPOSURE LENGTH

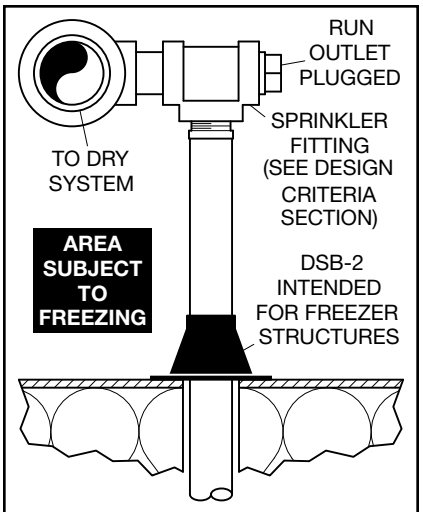


FIGURE 12
SPRINKLER FITTING UNHEATED AREA

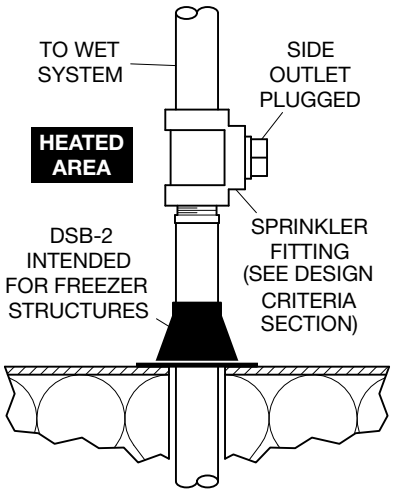


FIGURE 13
SPRINKLER FITTING HEATED AREA

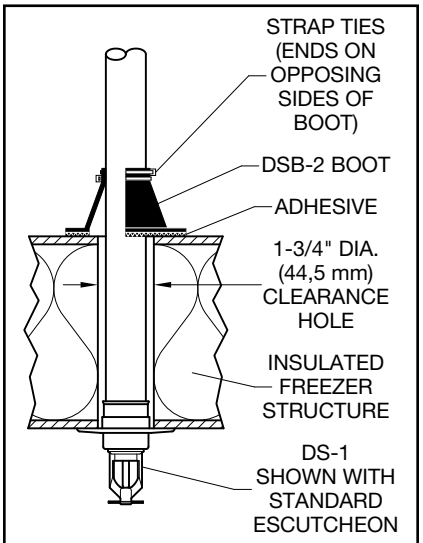


FIGURE 14
MODEL DSB-2 DRY SPRINKLER BOOT WITH PENDENT SERIES DS-1 DRY-TYPE SPRINKLER

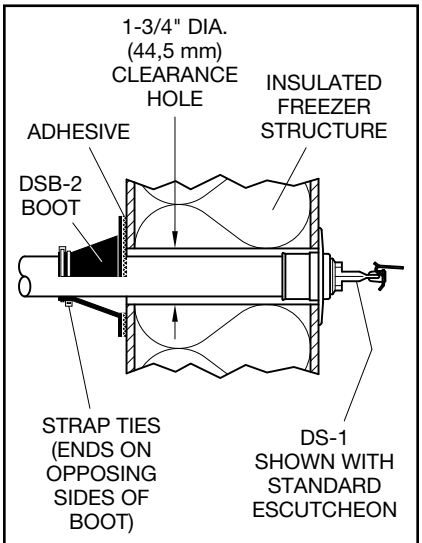


FIGURE 15
MODEL DSB-2 DRY SPRINKLER BOOT WITH SIDEWALL SERIES DS-1 DRY-TYPE SPRINKLER

P/N* 60 – XXX – X – XXX

		SIN
96	Pendent with Standard Escutcheon (1 in. NPT)	TY3255 (Figure 3)
93	Pendent with Deep Escutcheon (1 in. NPT)	TY3255 (Figure 5)
97	Pendent with Recessed Escutcheon (1 in. NPT)	TY3255 (Figure 4)
92	Pendent without Escutcheon (1 in. NPT)	TY3255 (Figure 6)
94	Sidewall with Standard Escutcheon (1 in. NPT)	TY3355 (Figure 8)
53	Sidewall with Deep Escutcheon (1 in. NPT)	TY3355 (Figure 9)
54	Sidewall without Escutcheon (1 in. NPT)	TY3355 (Figure 10)
98	Upright without Escutcheon (1 in. NPT)	TY3155 (Figure 7)

	Sprinkler Finish	Escutcheon Finish[1]
0	Chrome Plated	Signal White (RAL9003) Polyester
1	Natural Brass	Signal White (RAL9003) Polyester
2	Natural Brass	Brass Plated
4	Signal White (Ral9003) Polyester	Signal White (RAL9003) Polyester
8	Chrome Plated	Stainless Steel
9	Chrome Plated	Chrome Plated

	Sample Order Length[3]
055	5.50 in.
082	8.25 in.
180	18.00 in.
187	18.75 in.
372	37.25 in.
480	48.00 in.

	Temperature Rating[2]
1	155°F (68°C)
2	175°F (79°C)
3	200°F (93°C)

	Temperature Rating[2]
4	286°F (141°C)
5	360°F (182°C)

NOTES
1. Escutcheon Finish applies to sprinklers provided with escutcheons.
2. 360°F (182°C) temperature rating applies to non-recessed sprinkler assemblies.
3. Dry-type Sprinklers are furnished based upon "Order Length" as measured per Figures 3 through 10, as applicable, and for each individual sprinkler where it is to be installed. After the measurement is taken, round it to the nearest 1/4 in. increment.

* Use Prefix "I" for ISO 7-R 1 Connection (for example, I-60-961-1-180).

TABLE D
SERIES DS-1 DRY-TYPE SPRINKLERS, 5.6K, STANDARD RESPONSE
PART NUMBER SELECTION

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name, including description and part number (P/N).

Dry-type Sprinklers
When ordering Series DS-1 5.6K Pendent, Upright, and Horizontal Sidewall, Standard Response, Standard Coverage Dry-type Sprinklers, specify the following information:

- SIN:

  TY3255 – Pendent
  TY3155 – Upright
  TY3355 – Horizontal Sidewall

- Order Length:

  Dry-type sprinklers are furnished based upon order length as measured according to Figures 3 through 10, as applicable. After the measurement is taken, round it to the nearest 1/4 in. increment.

- Inlet Connections:

  1 in. NPT (Standard)
  ISO 7-R 1

  (For information on ISO Inlet Thread Connections, contact your Johnson Controls Sales Representative.)

- Temperature rating
- Sprinkler finish
- Escutcheon type and finish, as applicable
- P/N from Table D

  Part numbers are for 1 in. NPT standard order sprinklers. Orders for all other sprinkler assemblies must be accompanied by a complete description.

Replacement Escutcheons
Order replacement escutcheons separately.

Note: *Style 10 recessed escutcheons are shipped as assemblies comprised of closure ring and mounting plate. The included mounting plate is not used for dry-type sprinkler applications, discard accordingly.*

Specify: (specify type) Escutcheon, (specify) finish, P/N (specify):

Recessed (Style 10)
Brass Plated. 56-701-2-010
Signal White (RAL9003). 56-701-4-010
Chrome Plated 56-701-9-010

Standard (Push-On)
White Color 91-106-0-007
Brass Plated. 91-106-2-007
Chrome Plated 91-106-9-007

Deep
Brass Plated. 91-107-2-010
White 91-107-4-007
Chrome Plated 91-107-9-007

Sprinkler Wrench
Specify W-Type 7 Sprinkler Wrench, P/N 56-850-4-001

Model DSB-2 Dry Sprinkler Boot
Model DSB-2 Dry Sprinkler Boot includes one boot, two strap ties, and 1/3 oz of adhesive, quantity of adhesive is sufficient for one boot installation.

Specify: Model DSB-2 Dry Sprinkler Boot, P/N 63-000-0-002

1467 Elmwood Avenue, Cranston, RI 02910 | Telephone +1-401-781-8220

© 2025 Johnson Controls. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.

NATIONAL FIRE PROTECTION ASSOCIATION and NFPA are registered trademarks of National Fire Protection Association;
TEFLON is a trademark of The Chemours Company FC, LLC

Johnson Controls